

Geothermal Development in Iceland 2020-2022

Árni Ragnarsson*, Benedikt Steingrímsson and Sverrir Thorhallsson

*Iceland GeoSurvey (ÍSOR), Urdarhvarfi 8, 203 Kópavogur, Iceland

arni52@outlook.com, benedikt.steingrimsson@outlook.com, sverrir.thorhallsson@gmail.com

Keywords: Iceland, geothermal energy, power generation, direct use, space heating, district heating, country update

ABSTRACT

Geothermal energy is used for both electricity generation and direct heat applications in Iceland. The share of geothermal energy in the nation's primary energy supply is 65%. Nine geothermal power plants are in operation in the country with a total installed capacity of 755 MW_e. The annual electricity generation is almost 6 TWh_e, which is around 30% of the electricity produced in the country. Three of the geothermal power plants are co-generation plants that produce both electricity and heat for district heating. The largest power plant is at Hellisheidi (303 MW_e), which has been in operation since 2006, and the newest one is at Reykholt, 0.3 MW_e binary power plant. Space heating is the most important direct utilization of geothermal energy in Iceland, covering over 90% of all energy used for house heating in the country. Other sectors of direct use are swimming pools, snow melting, industrial process heat, greenhouses, aquaculture and soil warming. The geothermal fluid is also a source of silica and salts for skin care products and liquid carbon dioxide (CO₂) for soft drinks, greenhouses and industry. In parallel with increased tourism several new geothermal spas have been established around the country. Also, a district heating system serving about 2,500 people has recently been converted from a system based on electric boilers to a geothermal district heating system. The total direct use of geothermal energy in Iceland is estimated to be about 35,000 TJ annually.

1. INTRODUCTION

Iceland has a huge geothermal potential based on the location of the country on a hot spot on the Mid-Atlantic Ridge. The country is mountainous and volcanic, with much precipitation, making hydropower resources also abundant. The population of Iceland is about 380,000, of which almost two third live in the Reykjavik capital area. During the course of the 20th century, Iceland went from being one of Europe's poorest countries, dependent upon peat, dung and imported coal for its energy, to a country with a high standard of living where practically all stationary energy, and roughly 83% of the primary energy supply comes from indigenous renewable sources (65% geothermal (referenced to 15°C), 18% hydropower (generated electricity)). The rest comes mainly from imported fossil fuel used for the transport sector and fishing fleet. Iceland's energy use per capita is among the highest in the world and the proportion provided by renewable energy sources exceeds most other countries.

The geothermal resources in Iceland are used for both electricity generation and direct uses. In the high-temperature (>200°C) fields the geothermal steam fraction is utilized for electricity generation at seven sites. Heat from the turbine condenser and the brine fraction is used to heat freshwater for district heating in so-called co-generation plants at three of the sites. Thus, the energy efficiency is improved considerably. The low-temperature (<150°C) fields are used mainly to supply hot water for district heating but also for power generation. There are three small binary power plants: Flúðir (0.6 MW_e) in the south of Iceland and in West Iceland at Reykholt (0.3 MW_e) and Deildartunga (0.04 MW_e). Larger binary units are at Svartsengi (7 x 1.2 MW_e) in use since 1989-1992. The current utilization of geothermal energy for heating and other direct uses is considered to be only a small fraction of what this resource can provide.

It has been the policy of the Government of Iceland to increase the utilization of renewable energy resources even further for power generation, direct uses and the transport sector. A broad consensus on conservation of valuable natural areas has been influenced by increased environmental awareness. Thus, there has been opposition against hydropower and some geothermal projects. The ownership of energy resources in Iceland is based on the ownership of land. However, exploration and utilization are subject to licensing.

A master plan assessing the economic feasibility and the environmental impact of selected power development projects was adopted by the Icelandic Parliament about 25 years ago. It is a tool to reconcile the, often competing, interests of nature conservation and energy utilization on a national scale and at the earliest planning stages. In June 2022 a parliamentary resolution for the third phase of the master plan was adopted by the Icelandic parliament and preparatory work on the fourth phase has already been ongoing for some years. (The Master Plan for Nature Protection and Energy Utilization, 2022).

2. OVERVIEW OF GEOTHERMAL UTILIZATION

Figure 1 and Table 1 show a breakdown of the direct uses of geothermal energy in Iceland for 2021 as well as the total geothermal electricity generation in that year (Orkustofnun A and B, 2023). The categories of direct uses are the same as requested in the data tables submitted for the World Geothermal Congress (WGC2023). However, further discussion of direct uses in chapters 4 and 5 of this paper will follow the direct use categorization that has been used for previous WGCs.

Direct uses of geothermal energy were in total 35,615 terajoules (TJ) in 2021, which corresponds to 9,893 GWh_{th} of used energy. Calculation of the used energy is based on estimated inlet and outlet water temperature for each category (e.g. 35°C outlet temperature for space heating) and the corresponding annual flow. The 72.8% share of space heating was by far the largest geothermal direct use sector. The total electricity production by geothermal amounted to 5,788 GWh_e or 20,837 terajoules.

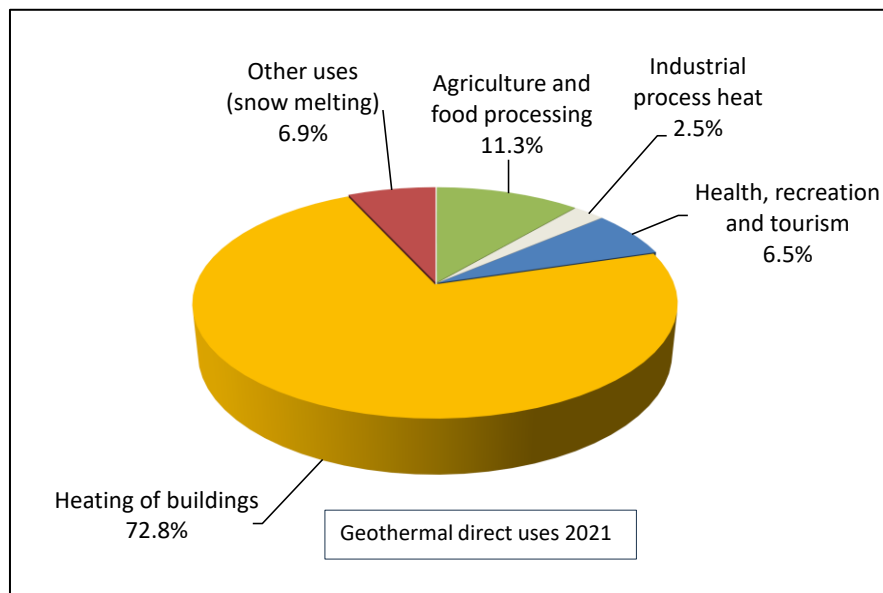


Figure 1: Sectoral share of direct use of geothermal energy in Iceland 2021 (Orkustofnun A and B, 2023).

Table 1: Installed geothermal capacity and energy consumption in Iceland 2021.

Utilization sector	Installed capacity	Energy consumption	
	MW _{th}	TJ/year	GWh/year
Agriculture and food processing	320	4,032	1,120
Industrial process heat	70	886	246
Health, recreation and tourism	184	2,325	646
Heating of buildings	2,054	25,914	7,198
Other uses (snow melting)	195	2,458	683
Direct uses total	2,823	35,615	9,893
	MW _e	TJ/year	GWh/year
Electricity generation	755	20,837	5,788

3. GEOLOGICAL BACKGROUND

Iceland is a geologically young country located in the North Atlantic astride the Mid-Atlantic Ridge, which is the boundary between the North American and Eurasian tectonic plates. The two plates are moving apart at a rate of about 2 cm every year. Geological and tectonic processes are extraordinary rapid and easily observed in Iceland. Some 20-30 volcanic eruptions occur every century on average, producing lava in the order of 45 km³ every 1000 year. The latest eruption episode was March 2021 for six months and again August 2022 for just three weeks at Fagradalsfjall mountain on Reykjanes peninsula, 32 km south of the capital city Reykjavik. Some 400 km are exposed of the Mid-Atlantic ridge which makes it possible to observe on land a variety of tectonic processes such as volcanism and associated features. Numerous volcanoes and hot springs are found in the country and earthquakes are frequent. The volcanic zone crosses the island running from the southwest to the northeast. More than 200 volcanoes are located within this zone and at least 30 of them have erupted since the country was settled about 1150 years ago. Associated with the volcanoes are numerous geothermal systems, ranging from freshwater to saline in composition and from warm to supercritical in temperature. At least 25 high-temperature areas exist on land within the volcanic zones with temperatures reaching 200°C above 1000 m depth and several HT-fields are expected to be (a few are known) in ocean ridges southwest and north of Iceland. About 250 separate low-temperature areas with temperatures not exceeding 150°C in the uppermost 1000 m have been identified, mostly in the areas flanking the active volcanic zones. Over 600 hot spring areas (temperature over 20°C) have been located (Figure 2).

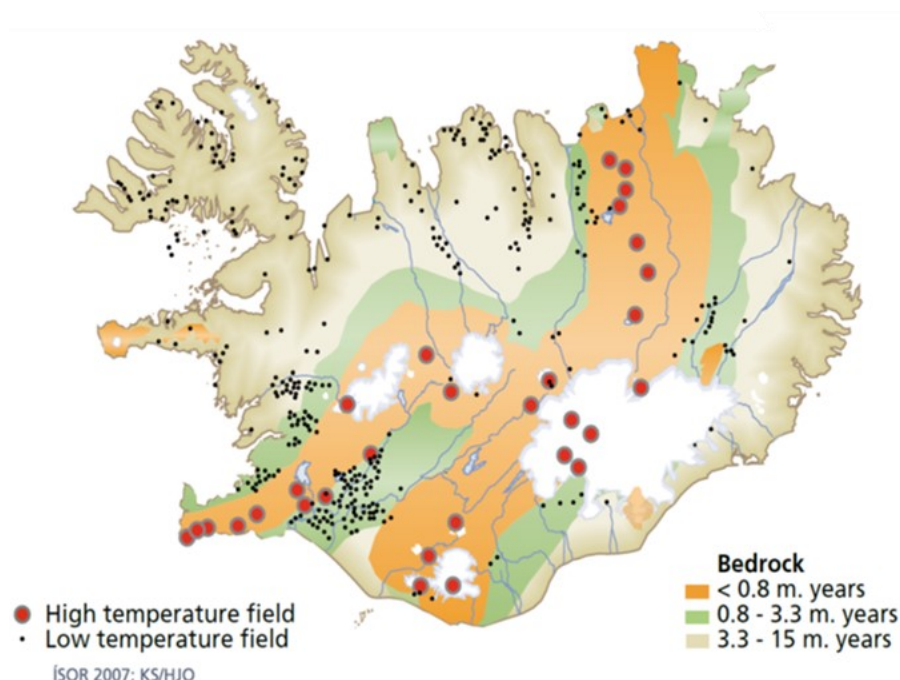


Figure 2: Volcanic zones and geothermal areas in Iceland.

4. SPACE HEATING

Direct uses and especially space heating play a predominant role in the geothermal utilization in Iceland. The pioneer was a farmer at Sudur-Reykir in the vicinity of Reykjavík who started using geothermal water for heating his house in 1908 by transporting water from a hot spring through a pipeline over a distance of about 500 m. Utilization of geothermal energy for space heating on a large scale began with the laying of a 3 km long hot water pipeline from the hot springs of Laugardalur in Reykjavík in 1930. The formal establishment of Reykjavík Municipal District Heating Service (now Reykjavík Energy) was in 1946. Following the oil price hikes of the 1970s, the Government took the initiative in eliminating oil from district heating, replacing it with geothermal energy, with the result that the share of geothermal energy increased from 43% in 1970 to the current level of over 90%. Buildings outside geothermal regions have electric heating. This development is illustrated in Figure 3. About 30 separate geothermal district heating systems are operated in towns and villages in the country and additionally some 200 small systems in rural areas. These smaller systems supply hot water to individual farms or a group of farms as well as summerhouses, greenhouses and other users. Geothermal space heating has enabled Iceland to import less fossil fuel and has resulted in a very low heating cost compared to most other countries. Using geothermal energy, which is classified as a renewable energy source, for space heating has also benefited the environment. Although most of the towns and villages in Iceland with the possibility of geothermal heating have already such a system in operation, exploration activities are ongoing with the aim to develop geothermal heating in new areas for the remaining villages and rural areas. The total geothermal energy used for space heating in Iceland in 2021 is estimated to be 25,914 TJ (Table 1).

A geothermal district heating system for the town Hofn (Hornafjörður) in southeastern Iceland, which has about 2,500 inhabitants, was commissioned in 2021 after many years of geothermal exploration in the area. The low-temperature geothermal water is transported to the town in a pipeline from the geothermal field at Hoffell about 20 km away. Before this new development the district heating system at Hofn had been operated for decades, the heat coming from electric boilers.

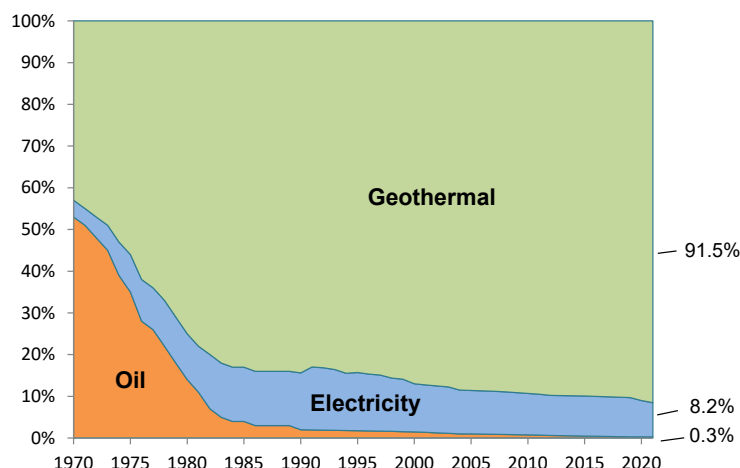


Figure 3: Energy sources used for space heating in Iceland 1970-2021.

4.1 District heating in Reykjavík

Reykjavík Energy (Orkuveita Reykjavíkur) is a public utility responsible for production, distribution and sale of both hot water and electricity as well as the city's waterworks and sewage system and fibre optic cables. The principal owner is the City of Reykjavík, and since 2014 it provides its services through three subsidiaries; Veitur Utilities, ON Power and Reykjavík Fibre Network as well as the carbon mineralization company Carbfix since 2020. The total number of employees is about 500 and the turnover in 2021 was about 52,000 million ISK (410 million US\$ based on the average 2021 exchange rate). Reykjavík Energy is by far the largest geothermal district heating utility in Iceland. It serves in total about 240,000 people, the entire population of Reykjavík and neighbouring towns or about 65% of the Icelandic population.

District heating in Reykjavík began in 1930 when some official buildings and about 70 private houses received hot water from geothermal wells, located close to the old thermal springs in Reykjavík. In 1943 delivery of hot water from the Reykir field, 18 km from the city, started. The district heating system was expanded gradually over the years to the whole greater Reykjavík area. Today Reykjavík Energy utilizes low-temperature areas within and in the vicinity of Reykjavík as well as the high-temperature fields at Nesjavellir, about 27 km away since 1990 and Hellisheidi since 2010, about 20 km away. At Nesjavellir and Hellisheidi cold ground water is heated in co-generation power plants. In the past, a number of district heating systems were either bought or merged with Reykjavík Energy. Some are small systems in rural areas, but others are among the largest geothermal district heating systems in the country serving towns with population of several thousand people. The total installed capacity of Reykjavík Energy's district heating system is about 1,250 MW_{th} and the total hot water production is about 90 million m³ per year.

4.2 HS Orka and HS Veitur

Hitaveita Sudurnesja (Sudurnes Regional Heating) was a pioneer in building the co-generation power plant at Svartsengi in 1976. It is located about 50 km SW of Reykjavík. In year 2000, the power plant and geothermal field operation was privatized and following changes in electricity legislation in 2008 the company was divided up into HS Veitur hf. and HS Orka hf. The plant in Svartsengi utilizes 240°C geothermal brine from the Svartsengi field to heat fresh water for district heating (190 MW_{th}), and to generate electricity (76.4 MW_e). HS Orka also has a 100 MW_e geothermal power plant on Reykjanes that was commissioned in 2006 for electricity generation only (expanded to 130 MW_e in the spring 2023).

4.3 Nordurorka – District heating in Akureyri

Akureyri is a town of about 20,000 inhabitants located in the north of Iceland. It has been heated by geothermal energy since the end of the 19-seventies. Hot water is pumped to Akureyri from six different geothermal fields. In addition to this, two 1.9 MW_{th} heat pumps supplied a small part of the annual energy production after their installation in 1984, but their contribution has been insignificant for many years. In the past, several small geothermal district heating systems in neighbouring communities have merged with Nordurorka. Thus, the total number of people served is now about 24,000. The total installed capacity is 100 MW_{th} and the annual hot water consumption about 9 million m³.

5. OTHER DIRECT UTILIZATION

5.1 Swimming and bathing

For centuries natural hot springs were mainly used for bathing in Iceland, but since early in the last century outdoor swimming pools as we know them today have been gaining popularity and they are now a part of the daily life all year round. There are about 170 recreational swimming centers in the country, 145 of which use geothermal heat to keep the water temperature at 28-30°C. The combined surface area of the geothermally heated pools is about 35,000 m². Most of the swimming pools are open to the public throughout the year. They serve for recreational purposes and are also used for swimming lessons, which are compulsory in schools. Swimming is very popular in Iceland and swimming pool attendance has increased in recent years. In the greater Reykjavík area alone, there are fifteen public outdoor pools and a few indoor ones as well. The largest of these is Laugardalslaug with 1,500 m² outdoor pools, 1,250 m² indoor pool and five hot tubs where the tub temperature ranges from 35 to 42°C. The number of people visiting Laugardalslaug annually is about 800 thousand. Among other balneological uses for geothermal energy are the Blue Lagoon, the bathing facility Mývatn Nature Bath (Jardbodinn) at Bjarnarflag close to Lake Mývatn, the Laugarvatn Fontana geothermal baths and the Secret Lagoon at Flúdir. The NLFI Spa and Medical Clinic in Hveragerði has indoor and outdoor pools, geothermal clay baths and water treatments. In recent years several new geothermal spas have been established like Vök baths at Urriðavatn, Geosea-Geothermal Sea Baths at Húsavík, Krauma in Reykholtssalur, Sky Lagoon in Kópavogur, Forest Lagoon in Eyjafjörður and Hvammsvík Hot Springs in Hvalfjörður.

Typically, about 220 m³ of geothermal water or 40,000 MJ of energy is needed annually for heating one m² of pool surface area. This means that a new, mid-sized (25 m long) outdoor swimming pool uses as much hot water as heating 80-100 single-family dwellings. The total geothermal energy used for heating swimming pools in Iceland in 2021 is estimated to be 2,325 TJ (Table 1).

The Blue Lagoon mentioned above is a 8,700 m² surface pond that receives effluent brine from the Svartsengi power plant (42 l/s). At the start of operations of the power plant in 1976 the effluent water was discharged into the surrounding lava field, which was to absorb the water due to its high permeability. People started bathing in the pond and psoriasis patients discovered that the water had a beneficial effect on their skin. Later, showering facilities were added and in 1999 a man-made lagoon with a temperature of 37-39°C was created along with improved facilities for visitors. The Blue Lagoon contains about 9 million liters of brine and the hydraulic retention time is about 40 hours. The salt content is 2.5%, close to 70% of seawater salinity. (Haraldsson and Cordero, 2014). In addition to the bathing facilities there are other important activities of the Blue Lagoon company. They operate a clinic for psoriasis patients that takes advantage of the therapeutic effects of the geothermal brine and produce a line of skin care products that contain unique natural ingredients, silica, minerals and algae. The number of Blue Lagoon visitors is almost one million per year, making it one of Iceland's most popular tourist attractions.



Figure 4: Heating of outdoor swimming pools and greenhouse heating are important geothermal applications in Iceland.

5.2 Snow melting

Geothermal water is used in Iceland to heat sidewalks and pavements to melt snow during the winter. These uses have been gradually increasing and today almost all new buildings in areas with geothermal heating have snow melting systems. Iceland's total area of snow melting systems is around 1,200,000 m², mostly in the capital area. Spent water from the houses at about 35°C is used for de-icing sidewalks and parking spaces. Most of the larger systems have the possibility to add water from the district heating system (80°C) when the load is high. The main purpose is often to prevent icing or to make removal of the snow easier, rather than directly melt the snow. In downtown Reykjavík, a snow-melting system, consisting of loops of buried plastic pipes, has been installed under most sidewalks and some streets, covering an area of 70,000 m². This system is designed for a maximum heat output of 180 W/m² surface area and the annual energy consumption is estimated to be 430 kWh_{th}/m². About two thirds of that energy comes from spent water from the space heating systems and one third directly from hot supply water. The total geothermal energy used for snow melting in Iceland in 2021 is estimated to be 2,458 TJ.

5.3 Industrial uses

The largest industrial user of geothermal energy in Iceland is the seaweed drying plant Thorverk, located at Reykhólar in West Iceland. The company harvests seaweed found in the shallow sea waters of Breidafjörður bay using specially designed harvester crafts. Once landed, the seaweed is chopped and dried in a belt dryer that uses large quantities of air, heated to 85°C by geothermal water. The plant has been in operation since 1975 and produces about 4,000 tonnes of rockweed and kelp meal annually. It uses 112°C hot geothermal water that is cooled down to 45°C in the drying process.

Since 1986, a facility at Haedarendi in Grímsnes, South Iceland, has produced commercial liquid carbon dioxide (CO₂) derived from the geothermal fluid of two gas rich wells. The Haedarendi geothermal field has an intermediate temperature (160°C) and a very high gas content in the total flow (1.4% CO₂). The gas discharged by the wells is nearly pure carbon dioxide. Upon flashing, the fluid from the Haedarendi well would deposit large amounts of calcium carbonate scaling. Scaling in the well is, however, avoided by installing 250 m and 300 m long downhole heat exchangers made of two coaxial stainless steel pipes. Cold water is pumped down through the inner pipe and back up the annulus. Through this process, the geothermal fluid is cooled to arrest boiling and rapid degassing. The solubility of calcium carbonate increases sufficiently at lower temperatures to prevent scaling (inverse solubility). The plant extracts approximately 15 l/s of water from the wells and produces some 10,000 tonnes of CO₂ annually, which practically covers the needs of the Icelandic market. The production is used in greenhouses to enrich the atmosphere, for manufacturing carbonated beverages and in other food industries. The cooling water reaches a temperature of 80°C and is used for a farm, a cluster of summer houses and for soil warming.

Geothermal energy has been used in Iceland for drying fish for about 40 years. The main application has been the drying of salted fish (bacalao), cod heads, fish bones, small fish, stockfish and other products. Cod heads were traditionally dried by hanging them on outdoor stock racks. Because of Iceland's variable weather conditions, indoor drying is preferred. Hot air is blown over the fish in batch dryers. Today about 10 companies dry cod heads indoors and all of them use geothermal hot water. The annual export of dried cod heads is about 10-12,000 tonnes. The product is exported mainly to Nigeria where it is used for human consumption. Among the largest Icelandic producers of dried cod heads is the company Haustak. They buy about 1.3 kg/s of geothermal steam at 18 bar (210°C) from the nearby Reykjanes power plant to produce annually 2,500 tonnes of dried product from 12,000 tonnes of raw material. The steam is used to heat fresh water up to 70°C for the drying process. Laugafiskur is another large fish drying plant by the Reykjanes power plant.

The Icelandic-American company Carbon Recycling International (CRI) has since 2012 operated a pilot plant that uses CO₂ emissions of non-condensable gas in the steam from the Svartsengi geothermal power plant of HS Orka to produce methanol to blend with gasoline to fuel cars. Hydrogen used in the process is produced locally by electrolysis of water. The current production capacity is 4,000 tonnes of methanol per year from about 5,500 tonnes of CO₂. Output from the plant is exported and used directly as a blend component for standard petrol or as a feedstock for biodiesel from esterified vegetable oil or animal fats.

Two small salt factories that utilize geothermal energy in their production have been established in Iceland in the last decade. The focus is on producing "gourmet" table salt. One of them is Nordursalt at Reykhólar in West Iceland, which has been in operation since 2013. They use over 100°C hot geothermal water to boil seawater at 51°C under sub-atmospheric conditions and to dry the salt.

The other salt factory is Saltverk at Reykjanes in Northwestern Iceland. They started operation in 2011 and utilize about 10 l/s of 90-95°C hot water from a geothermal well that is cooled down to 70°C in the salt production process.

Several other industrial processes utilizing geothermal energy have been operated in Iceland in the past. Among them was the Kísildjani diatomite plant at Lake Mývatn, which was among the largest industrial users of geothermal steam in the world. The plant used about 13 kg/s of steam at 180°C (9 bar) and produced about 28,000 tonnes of diatomaceous earth filter aids for export annually. Kísildjani was commissioned in 1968 and was operated until the plant was closed down in 2004 after 36 years of operation. Examples of other industrial applications that have been realized but are no longer in operation are: A salt production plant at the Reykjanes field utilizing geothermal brine and seawater, drying of imported hardwood in Húsavík by geothermal water, rethreading of car tires, and wool washing in Hveragerði. Among smaller ongoing activities using geothermal energy are a hospital laundry and steam baking of bread at several locations and a plant for curing concrete blocks in a steam heated autoclave. The total geothermal energy used as process heat in industry in Iceland in 2021 is estimated to be 886 TJ (Table 1).

The Icelandic company GeoSilica, which started as a university spin-off project, was founded in 2012. It produces silica health products from the mineral rich brine from the Hellisheidi power plant in cooperation with ON Power, the operator of the plant. The company's first product was released in late 2014, a liquid silica supplement made from 100% natural silica. Today the product line consists of five different types of food supplements. GeoSilica has plans for expansion and export of their products.

Vaxa Impact Nutrition is another company that utilizes natural outputs of the Hellisheidi power plant for their production. They grow microalgae for aquaculture fish feed and as nutritional supplements for people. From the power plant they get electricity for artificial lighting, cold and hot non-marine water, and carbon dioxide needed for algae to grow.

5.4 Greenhouse heating

Heating of greenhouses is one of the oldest and most important uses of geothermal energy in Iceland after space heating. Naturally warm soil had been used for outdoor growing of potatoes and other vegetables for a long time when geothermal heating of greenhouses started in Iceland in 1924. The majority of the greenhouses are located in the south, and most are enclosed in glass. The heating installations are of un-finned steel pipes hung on the walls and over the plants. Under table or floor heating is also common. It is also common to use inert growing media (volcanic scoria, rhyolite pumice) on concrete floors with individual plant watering. By using electric lighting, the growing season is extended to year-round, which improves the utilization of the greenhouses and increases the annual production. Artificial lighting, which also produces heat, has contributed to a diminishing demand for hot water supply to greenhouses. As a consequence of the lengthening of the growing season the need for new constructions diminished. CO₂ enrichment in greenhouses is common, primarily by using CO₂ produced in the geothermal plant at Haedarendi (see Chapter 5.3). Outdoor growing at several locations is enhanced by soil heating with geothermal water, especially during early spring.

The total surface area of greenhouses in Iceland is about 200,000 m² including plastic tunnels for bedding and forest plants. Of this area, which has not changed much in the past few years, 50% is used for growing vegetables (tomatoes, cucumbers, paprika etc.) and the rest mainly for growing cut flowers and potted plants. The total annual production of vegetables in Iceland is about 18,000 tonnes. The share of domestic production in the total consumption of tomatoes in Iceland is about 50% and for cucumbers almost 100%.

Most of the greenhouses in Iceland have automatic control of the indoor climate and thus, for example, the temperature can be adjusted to the optimum temperature for different kinds of crops, ranging from 10-15°C in nurseries up to 20-25°C for roses. Also, the temperature is commonly adjusted to follow the optimum daily variations. The main parameters that influence the heat loss from greenhouses and thereby the heating demand are the outdoor temperature, wind speed, greenhouse cover material, indoor temperature, artificial lighting, heating system arrangement and opening of the windows. A study made on energy consumption for heating a group of typical greenhouses in Iceland resulted in an average energy consumption of 3.67 GJ/m² per year in greenhouses with artificial lighting and 5.76 GJ/m² per year in greenhouses without artificial lighting (Haraldsson and Ketilsson, 2010). The total geothermal energy used in Icelandic greenhouses in 2021 is estimated to be 623 TJ.

5.5 Aquaculture

Fish farming was a slowly growing sector in Iceland for a number of years but the growth has been very rapid the last few years. The total production reached about 53,000 tonnes in 2021, of that 46,000 tonnes salmon. Other main species are arctic char, trout and Senegalese sole. There are about 60 fish farms in Iceland and of these between 15 and 20 utilize geothermal water. Geothermal water, commonly 20-50°C, is used to heat fresh water, either in heat exchangers or by direct mixing, typically from 5 to 12°C for juvenile production. The main use of geothermal energy in the fish farming sector in Iceland is for juvenile's production (char and salmon). Further rearing of salmon to full marketable size is made in sea cages where geothermal water is not used. Several large onshore salmon farms for grow-out are under construction. However, in land-based char production geothermal energy is used for post-smolt rearing to marketable size. Geothermal utilization in the fish farming sector is expected to increase in the coming years. The total geothermal energy used in the fish farming sector in Iceland in 2021 is estimated to be 3,205 TJ.

A fish farm owned by the company Stolt Sea Farm started breeding warm-water Senegalese sole at Reykjanes peninsula, Iceland, in 2013. It is the first stage of a large indoor land-based operation that is planned. The 22,000 m² plant is located close to the 100 MW_e (recently expanded to 130 MW_e) Reykjanes geothermal power plant owned by HS Orka. The power plant uses a large amount of sea water for the tubular power plant condensers, which is at the outlet at a temperature of 35°C. From there the warm sea water flows by gravity to the sea and a part of it goes to the fish farm. There it is mixed with sea water that is pumped from shallow wells and used in the rearing tanks at about 21°C, which is the optimum temperature for the fish. The juveniles are grown to about 500 g weight before the Senegalese sole is slaughtered and transported fresh to markets in Europe. The total production is about 400 tonnes per year.

6. ELECTRIC POWER GENERATION

Geothermal power accounts for a significant share of the electricity generation in Iceland. Table 2 gives an overview of the power plants and Figure 5 shows how the generation has developed during the period 1970-2021. The total installed capacity of geothermal generating plants is 755 MW_e. The total production in 2021 was 5,788 GWh_e, which is 29.5% of the total electricity production in the country (Orkustofnun B, 2023).

The first geothermal power plant in Iceland is in Bjarnarflag where a 3.2 MW_e back pressure unit started operation in 1969. The turbine was bought second hand from a sugar refinery. It was later refurbished and operated successfully until early 2018 except for two periods when it was out of service, 1978-1980 due to damage of production wells caused by volcanic activity, the Krafla Fire, in the area, and 1985-1988 due to rehabilitation of the power plant. In 2018-2019 the old turbine and generator was replaced by a new 5 MW_e back pressure unit, which started full production in late 2019. The new turbine uses the same amount of steam as the old one. The Bjarnarflag plant is using steam from a well in the Námafjall geothermal field within the lake Mývatn area in North Iceland. The same field has been used to supply heat for industrial applications (Kísildjani diatomite plant, closed down in 2004), district heating for the community and the Mývatn Nature Bath. Exploration drilling has been carried out in preparation of further development of the Námafjall field for a new 90 MW_e power plant in two stages.

The Krafla power plant is located near the lake Mývatn in North Iceland (about 10 km from the Bjarnarflag plant) and has been operating since 1978. Two 30 MW_e double flash condensing turbine units were purchased, but due to unexpected difficulties with steam supply the plant was run with only one installed turbine for the first 20 years. The shortfall of steam was due to volcanic activity, the Krafla Fire, that injected volcanic gases into the most productive part of the geothermal reservoir. Volcanic eruptions occurred only about two kilometers away from the power plant, posing a serious threat to its security. Initially, the power generation was only 8 MW_e, but reached 30 MW_e in 1984. The capacity of the Krafla power plant was expanded in 1997 from 30 to 60 MW_e by commissioning the second turbine, which reached full capacity in 1999. In total, about 40 wells have been drilled in the area. The plant uses 111 kg/s of 6.7 bar-g saturated high-pressure steam and 36 kg/s of 1.2 bar-g saturated low-pressure steam.

Table 2: Geothermal power plants in Iceland 2022.

Plant name	Plant size MW _e	Year	Unit size MW _e	No of units	Type	Temp. °C	Press. bar-g	Flow rate t/h	Production in 2021 GWh/yr
Krafla	60	1978	30	1	DF	172/122	6.7/1.2	400/130	388
		1997	30	1	DF				
Svartsengi	76,4	1978-1980	8	2	SF	155	4.5	124	570
		1989-1993	1.2	7	B	103	0.12	131	
		1999	30	1	SF	162	5.5	275	
		2007	30	1	DS	201	15	288	
Bjarnarflag	5	1969	5	1	SF	182	9.5	45	26
Nesjavellir	120	1998	30	2	SF	192	12	432	941
		2001	30	1	SF	192	12	198	
		2005	30	1	SF	192	12	198	
Reykjanes	100	2006	50	2	SF	210	18	576	657
Hellisheidi	303	2006	45	2	SF	178	8.5	600	2,571
		2007	33	1	SF	124	1.25	315	
		2008	45	2	SF	178	8.5	600	
		2011	45	2	SF	178	8.5	600	
Theistareykir	90	2017-2018	45	2	SF	178	8.5	560	631
Flúðir	0.6	2018	0.15	4	B	116		125	3
Reykholt	0.3	2021	0.15	2	B				0.4
Total	755			32				5,332	5,788

SF: Single flash; DF: Double flash; DS: Dry steam; B: Binary

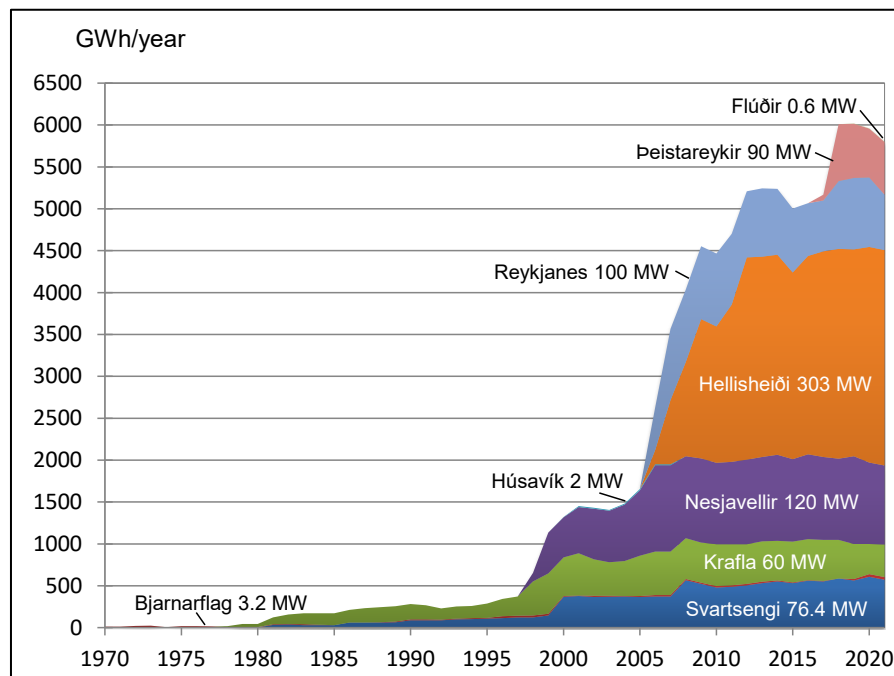


Figure 5: Electricity generation by geothermal energy in Iceland 1970-2021.

The Svartsengi co-generation power plant of HS Orka started operation in 1976 with hot water production only until electricity generation started two years later. The plant is located on the Reykjanes peninsula, 50 km from Reykjavík, and serves about 30,000 people. The reservoir fluid is a brine at 240°C and with a salinity of about two thirds of sea water. The total production from the reservoir is about 450 kg/s. Of that about 60% is reinjected. Geothermal heat is transferred to freshwater in several heat exchangers. After expanding the plant in several steps, the total installed capacity in Svartsengi is now 190 MW_{th} for hot water production and 76.4 MW_e for electricity generation in several units (see Table 2). Of that 8.4 MW_e come from Ormat binary units using low-pressure exhaust steam. A part of the effluent brine from Svartsengi (42 l/s) goes to the Blue Lagoon (see Chapter 5.1), the rest is reinjected into the reservoir.

HS Orka started operation of a 100 MW_e geothermal power plant at Reykjanes in May 2006 (two 50 MW_e steam turbines with sea water cooled condensers). The plant uses 160 kg/s of steam at 18 bar. In the spring 2023, a 30 MW_e expansion of the plant started operation. It is based on utilization of flash-steam from the high-pressure separator brine from the original plant, without increasing the fluid extraction from the geothermal reservoir. This new unit is not included in the statistical data presented in this paper.

Reykjavík Energy (ON Power) has been operating a co-generation power plant at Nesjavellir high temperature field north of the Hengill volcano since 1990. A mixture of steam and geothermal water is transported from the wells to a central separator station at 192°C and 12 barg. The primary purpose of the plant was to provide hot water for the Reykjavík area, 27 km away and during the first eight years only the heating plant was in operation, heating fresh groundwater by geothermal steam and hot water in heat exchangers. After the electric plant was commissioned in 1998 the preheating of the freshwater is within the turbine condensers and thereafter by utilizing the water fraction from the separators. After deaeration a small amount of geothermal steam containing hydrogen sulfide is injected into the water to remove any remaining oxygen and thereby preventing corrosion and scaling. The hot water is pumped from the power plant, which is at an elevation of 160 masl, to a large surge tank at an elevation of 400 masl from where it flows by gravity to large storage tanks on the outskirts of Reykjavík before distribution. The capacity of the plant is about 300 MW_{th}, which corresponds to 1,640 l/s of district heating water at 83°C. The power plant started generating electricity in 1998 when two 30 MW_e steam turbines were put into operation. In 2001, a third turbine was installed, and the plant enlarged to a capacity of 90 MW_e, and finally to 120 MW_e in 2005 when the fourth turbine was installed (see Table 2).

Reykjavík Energy (ON Power) started operation of a new 90 MW_e geothermal power plant at Hellisheiði in the southern part of the Hengill area in October 2006. It was expanded by a 33 MW_e low pressure unit (bottoming plant) in 2007 and further by installing two 45 MW_e units in late 2008 and additionally two 45 MW_e units in 2011, increasing the total installed capacity of the plant to 303 MW_e. Hot water production for district heating in Reykjavík started at Hellisheiði in 2010. It has the capacity of 200 MW_{th}, which corresponds to 950 l/s of district heating water. Due to increased demand for steam, additional four wells drilled in a nearby area in the period 2006-2009 were connected to the plant at the end of 2015. Originally, these wells were planned for a new 90 MW_e power plant that was expected to be built in the area (Hverahlíð), but it was later decided to transport the steam over a distance of 5 km to maintain full generation in the Hellisheiði plant.

Reykjavík Energy, in cooperation with Icelandic and foreign scientists, has developed a process to capture CO₂ and other sour gases from geothermal power plants and permanently store it as rock in the subsurface. The process is based on dissolving the geothermal gases in water before injection into the bedrock where minerals will be formed in the same way as happens in the nature. After several years of research and pilot phases at Hellisheiði, Carbfix has been operated as a subsidiary of Reykjavík Energy since 2020. A hydrogen sulphide abatement unit is located at the Hellisheiði power plant, which uses the Carbfix process to filter out 75% of the

hydrogen sulphide and 30% of the carbon dioxide which is redissolved in the geothermal fluids and conducted into the re-injection system.

Landsvirkjun (The National Power Company) operates a 90 MW_e power plant at Theistareykir geothermal field in North Iceland, not far from the Krafla geothermal field. The construction work started in 2015 and the first 45 MW_e unit was commissioned in November 2017 and the second 45 MW_e in April 2018. The field had been under exploration since 1973. The first deep exploration well was drilled in 2002 and a total of 18 geothermal wells were drilled up to 2017 for production and reinjection. The main part of the power from the Theistareykir plant goes to a production plant for silicon metal in the nearby town Húsavík, which has a production capacity of 32,000 tonnes per year.

The project developer Varmaorka focuses on harnessing low-temperature geothermal resources for power generation. They have entered a collaboration with the Swedish binary plant supplier to deliver geothermal binary generation units. The modules are planned to be placed in several locations in Iceland. Their first project consists of four modules, 150 kW_e each, at Flúdir in southern Iceland, commissioned in June 2018. The binary units use geothermal water at 116°C that is cooled down to 76°C in the power generation process. The effluent water is planned to be used for district heating in the future. Varmaorka's second project was a 300 kW_e geothermal binary unit at Reykholt, Borgarfjörður. One additional small-scale geothermal binary plant that has been built is a 40 kW_e unit at the spa Krauma at Deildartunga, Reykholtssdalur.

7. CONCLUSIONS

In general, Iceland's geothermal utilization story is a successful one. Over a few decades Iceland has become largely independent in regard to primary energy use by utilizing local energy sources, geothermal and hydro. This has limited the need for importing fossil fuels so now Iceland is only using fossil fuels within the fishery fleet and transport sector. In the attempt to meet the international climate goals, Iceland is now focusing on eliminating the use of fossil fuels within the fishery sector and transport sector. To reach this goal, it is important to speed up the energy transition and focus on solutions like electric vehicles and liquid hydrogen for ships. The main ongoing activity on further geothermal electricity generation in Iceland is drilling of new wells and other preparations for a 45 MW_e expansion of the Theistareykir power plant.

ÍSOR (Iceland GeoSurvey) completed in 2023 a study on the performance of about 50 geothermal fields that supply hot water to all the main district heating systems in Iceland, with focus on low-temperature geothermal fields (Hauksdóttir et al., 2023). The status of exploration and monitoring of the resources as well as long-term development of the utilization was examined. The results show that about two third of the district heating systems foresee increased hot water demand that will be difficult to meet. That demand is for a large part related to the increased amount of water needed for domestic heating, but also due to large-scale users or industries. With new research methods, technological development and improved processing methods and knowledge, increased hot water production from geothermal fields can be expected. On the basis of this study, the Government initiated an effort to increase geothermal exploration and space heating through grants issued by the public energy fund.

ACKNOWLEDGEMENTS

The statistical data presented in this country update paper are mostly based on energy data provided by Orkustofnun (National Energy Authority of Iceland). As data on direct uses of geothermal energy for 2021 have not yet been published, Orkustofnun has provided preliminary data for that year that might differ somewhat from the final data. The authors would like to thank Orkustofnun for the support in completing the geothermal data tables for this paper.

REFERENCES

- Haraldsson, I.G. and Cordero, A.L.: Geothermal baths, swimming pools and spas: Examples from Ecuador and Iceland, Short Course VI on Utilization of Low- and Medium-Enthalpy Geothermal Resources and Financial Aspects of Utilization, organized by UNU-GTP and LaGeo, Santa Tecla, El Salvador, (2014), 14 pp.
- Haraldsson, I.G. and Ketilsson, J.: Utilization of geothermal resources for electricity generation and direct applications, Orkustofnun (National Energy Authority, Iceland), report OS-2010/02, (2010) (in Icelandic), 62 pp.
- Orkustofnun A: Unpublished preliminary data on direct use of geothermal energy in Iceland, June, 2023.
- Orkustofnun B: OS-2023-T001-01: Installed capacity and electricity production in Icelandic power stations in 2021, Orkustofnun, Reykjavík, 2023.
- Ragnarsson, Á., Steingrímsson, B., Thorhallsson, S.: Geothermal development in Iceland 2015-2019, Proceedings, World Geothermal Congress 2020, Reykjavík, Iceland, October 24-27, 2021.
- Ragnarsson, Á., Steingrímsson, B., Thorhallsson, S.: Geothermal Energy Use, Country Update for Iceland, Proceedings, European Geothermal Congress 2022, Berlin, Germany, October 17-21, 2022.
- Hauksdóttir, S., Óladóttir, A.A., Gautason, B., Óskarsson, F., Ólafsson, M., Kristinsson, S.G.: Hitaveitur á Íslandi. Úttekt á stöðu hitaveitna og nýtingar jarðhitavats til húshitunar, Umhverfis-, orku- og loftslagsráðuneytið, (2023).
- The Master Plan for Nature Protection and Energy Utilization, website 2022: <http://www.ramma.is/english>.